


Houston County Electric Cooperative
Crockett, Texas

**UNDERGROUND SPECIFICATION
POLE CONDUIT TO METER ON HOUSE**

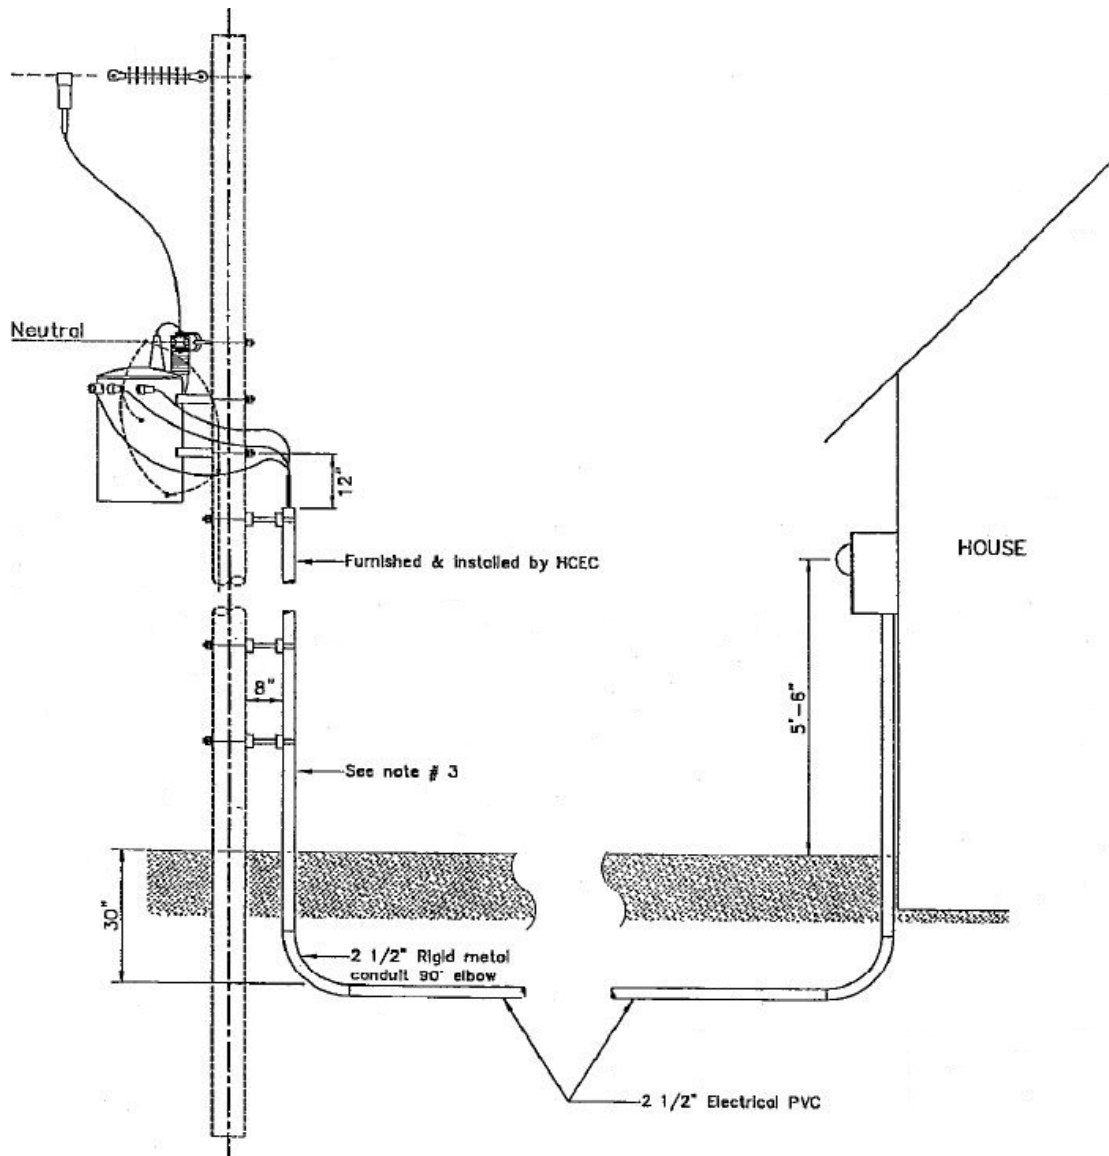

NOTES:

1. Member will be responsible for digging ditch and installing wire in conduit with elbow. Minimum depth of 30".
2. Co-op will furnish wire from house to transformer and underground meter base.
3. Member to install up to 18" AGL with threaded nipple.